
Abmessungen RAC-50WEC



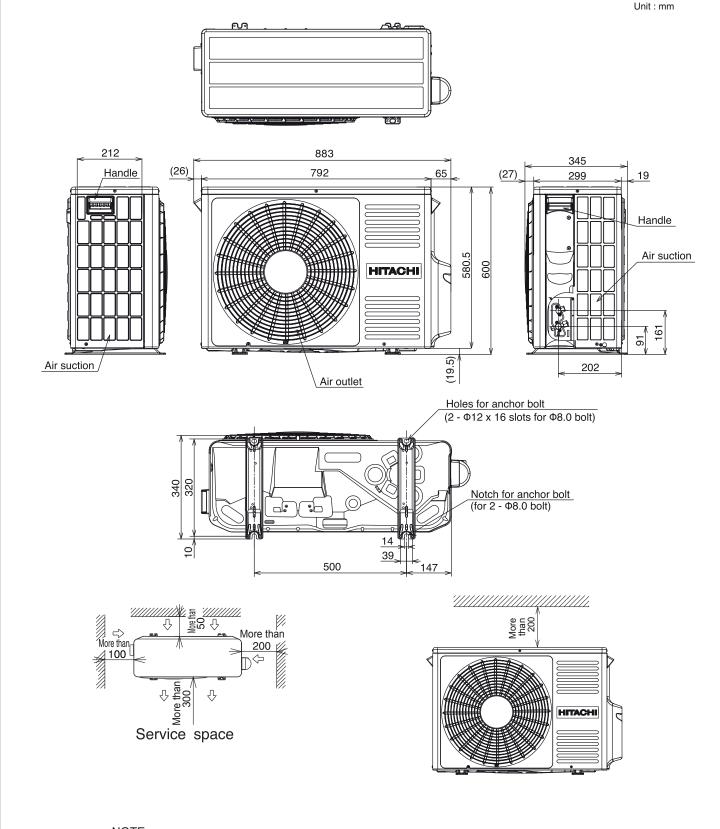

NOTE:

- $1. For \ outdoor \ unit \ installation \ , \ allow \ at \ least \ 2 \ sides \ of \ space \ around \ the \ unit \ ensure \ ventilation \ flue.$
- 2. The connecting pipe, should all the insulated with insulation pipe.
- 3. Piping length is within 20m.
- 4. Height different of the piping between the indoor unit and outdoor unit should be within 10m.